


ANALOG SENSOR BASES



YBN-NSA-4

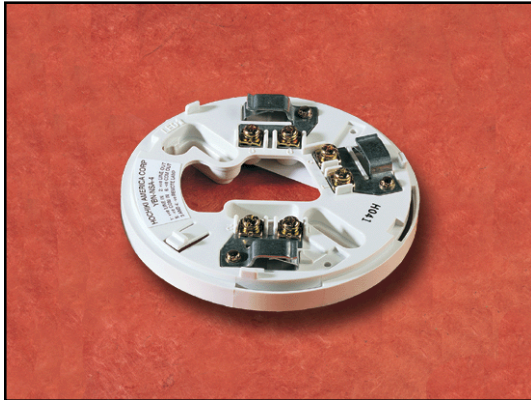

HSB-NSA-6

STANDARD FEATURES

- UL & ULC Listed
- Designed for use with all NS analog sensors.
- Available in 4 and 6 inch models.
- Contains a security locking tab for tamper protection.

SPECIFICATIONS

YBN-NSA-4	4 inches
HSB-NSA-6	6 inches
Security Feature	Plastic Tamper-Lock
Color	Bone PC / ABS Blend

Specifications subject to change without notice.

APPLICATION

The HOCHIKI America YBN-NSA-4 and the HSB-NSA-6 mounting bases are electronics free and contain a simple rugged design with screw terminals for wiring connections. A common mounting base allows sensor interchange and maintains loop continuity when sensors are removed. A simple anti-tamper head locking system is provided which is enabled by removing a small plastic tab on the back of the sensor. Once locked, the head can only be removed using a small diameter screw driver.

OPERATION

The YBN-NSA-4 and HSB-NSA-6 are designed specifically for use with the Hochiki NS Analog models AIE-EA Ionization Smoke Sensor, ALG-V Photoelectric Smoke Sensor and ATG-EA Heat Sensor.

The YBN-NSA-4 and HSB-NSA-6 common mounting bases allows for complete compatibility for all of the Hochiki NS Series Analog sensors. The bases are lightweight and very thin, providing a low profile once installed. The solder-less screw terminals enable quick and easy wiring connections.

PRODUCT LISTINGS

Underwriters Laboratories: S1383
 Underwriters Laboratories of Canada: CS463
 CSFM #: 7300-0410:132
 FM#: 3022559
 MEA Report #: 284-91-E Vol. IV

Continued on back.

Hochiki America Corporation

7051 Village Drive, Suite 100 Buena Park, CA 90621-2268
 Phone: 714/522-2246 Fax: 714/522-2268
 Technical Support: 800/845-6692 or technicalsupport@hochiki.com

Find latest revision at www.hochiki.com



ENGINEERING SPECIFICATIONS


The base shall permit direct interchange with the HOCHIKI America AIE-EA ionization type smoke sensor, ALG-V photoelectric smoke sensor, and the ATG-EA heat sensor.

The sensitivity of the sensor shall be capable of being measured by the control panel.

The vandal-resistant, security locking feature shall be used in those areas as indicated on the drawing. The locking feature shall be optional and can be implemented when required.

It shall be possible to perform a functional test of the sensor without the need of generating smoke. The test method shall simulate the effects of products of combustion in the chamber to ensure testing of internal circuitry.

TYPICAL WIRING DIAGRAMS

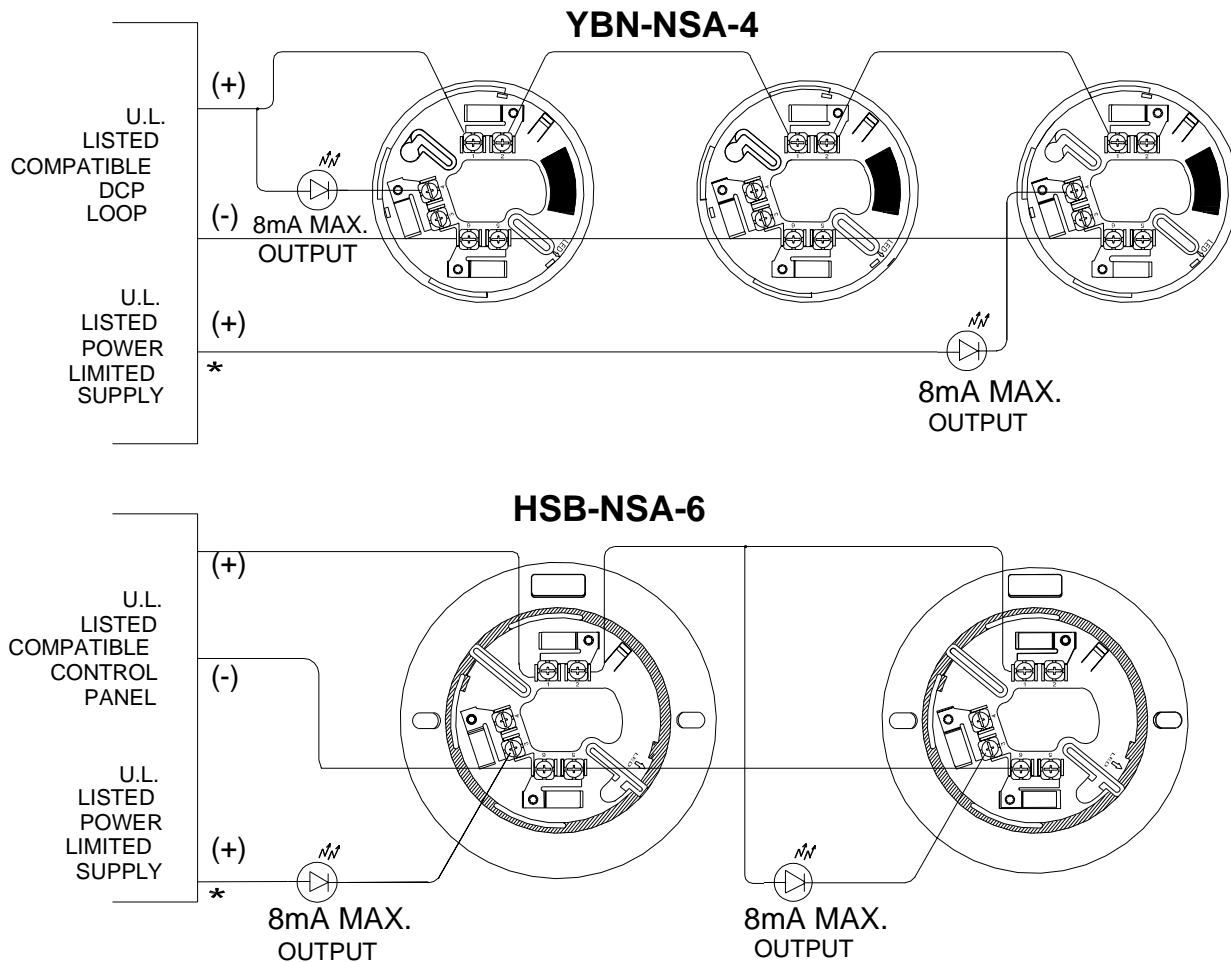

* - OPTIONAL WIRING CONFIGURATIONS FOR REMOTE OUTPUT

NOTE: Fire alarm control panel compatibility is required for DCP products.
State-of-the-art communications protocol, DCP, allows system components (DCP sensors AIE-EA, ALG-V and ATG-EA, bases and modules), to be used concurrently in a system's signaling line circuit.